


# Installation

## S19-110BFSS

### Freestanding Drench Shower

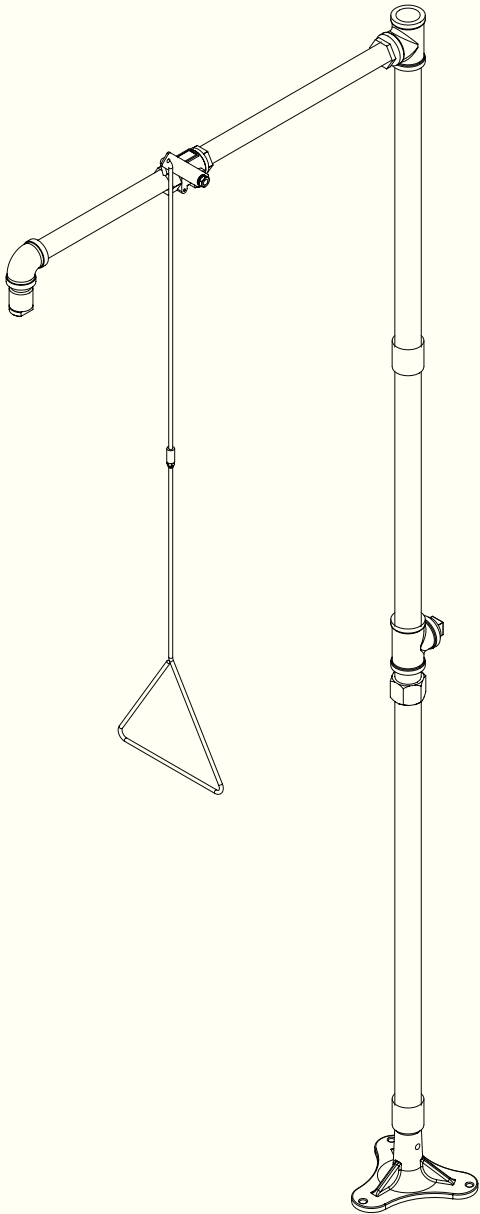


#### Table of Contents

Pre-Installation Information .....	2
Installation Instructions .....	3
Assembly of Components .....	4
Parts List .....	5

[Bradley S19-110BF Free Standing Drench Shower Barrier Free](#)

[Bradley S19-110BFSS Stainless Steel Free Standing Drench Shower - Barrier Free](#)


**⚠ IMPORTANT ⚠**




Read this installation manual completely to ensure proper installation, then file it with the owner or maintenance department. Compliance and conformity to drain requirements and other local codes and ordinances is the responsibility of the installer.



Separate parts from packaging and make sure all parts are accounted for before discarding any packaging material. If any parts are missing, do not begin installation until you obtain the missing parts.



Flush the water supply lines before beginning installation and after installation is complete. Test the unit for leaks and adequate water flow. Main water supply to the eyewash should be "ON" at all times. Provisions shall be made to prevent unauthorized shutoff.



The ANSI Z358.1 standard requires an uninterrupted supply of flushing fluid at a minimum 30 PSI (0.21 MPa) flowing pressure. Flushing fluid should be tepid per ANSI Z358.1.



The inspection and testing results of this equipment should be recorded weekly to verify proper operation. This equipment should be inspected annually to ensure compliance with ANSI Z358.1.



Workers who may come in contact with potentially hazardous materials should be trained regarding the placement and proper operation of emergency equipment per ANSI Z358.1.



## Installation

### Supplies Required:

- (3)  $\frac{3}{8}$ " floor anchors and bolts
- Pipe sealant
- Piping to  $1\frac{1}{4}$ " NPT water supply inlet on unit
- Adequate supply pipe supports
- Min. 4" drain to accommodate 30 gallons per minute discharge for shower waste
- OPTIONAL: sign-mounting hardware

### Step 1: Secure base to floor

1. Install three suitable anchors (supplied by installer) for  $\frac{3}{8}$ " bolts in the floor.
2. Bolt the base to the floor anchors using  $\frac{3}{8}$ " bolts (supplied by installer).

### Step 2: Assemble components


1. Assemble the remaining unit components as shown on page 4.
  - Apply pipe sealant (by installer) to all male-threaded pipe joints.
  - Use the rubber grip pad provided or a strap wrench around pipes when tightening to prevent marring. Place the grip pad on the pipe, then put the wrench over the grip pad and turn the pipe with the wrench.
  - Bottom edge of showerhead should be 84" (2134mm) from floor.

### Step 3: Connect water supply




#### **IMPORTANT: Do not rely on Bradley's Combination Unit to support supply piping.**

1. Connect water supply piping to  $1\frac{1}{4}$ " NPT inlet on unit (piping by installer). Provide adequate supports (by installer) for supply pipe using pipe hangers or other means.
2. Hang the safety sign from the unit with the curtain hooks provided (or mount it to the wall using sign-mounting hardware by installer).

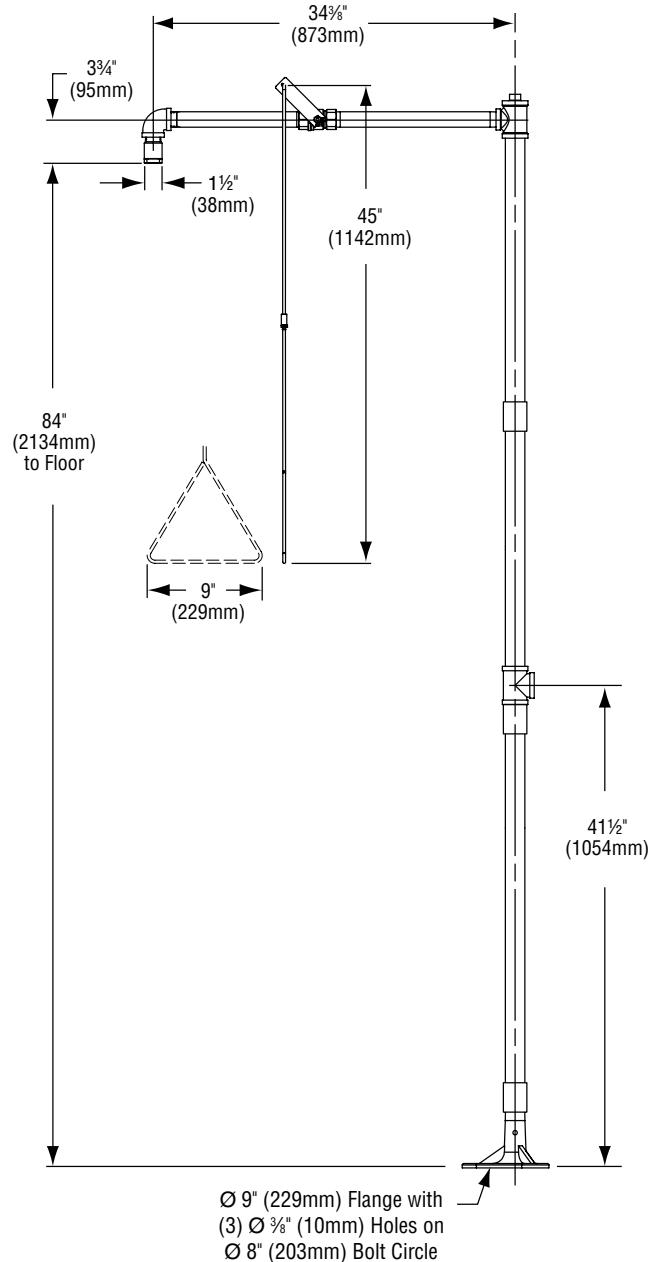

**NOTE: All dimensions assume standard thread engagement. Variations in manufacturing allow for  $\pm 1/8$ " (3mm) per threaded joint. To find the tolerance of a dimension, add the number of thread joints in between a dimension and multiply it by  $1/8$ " (3mm).**

# Assembly of Components

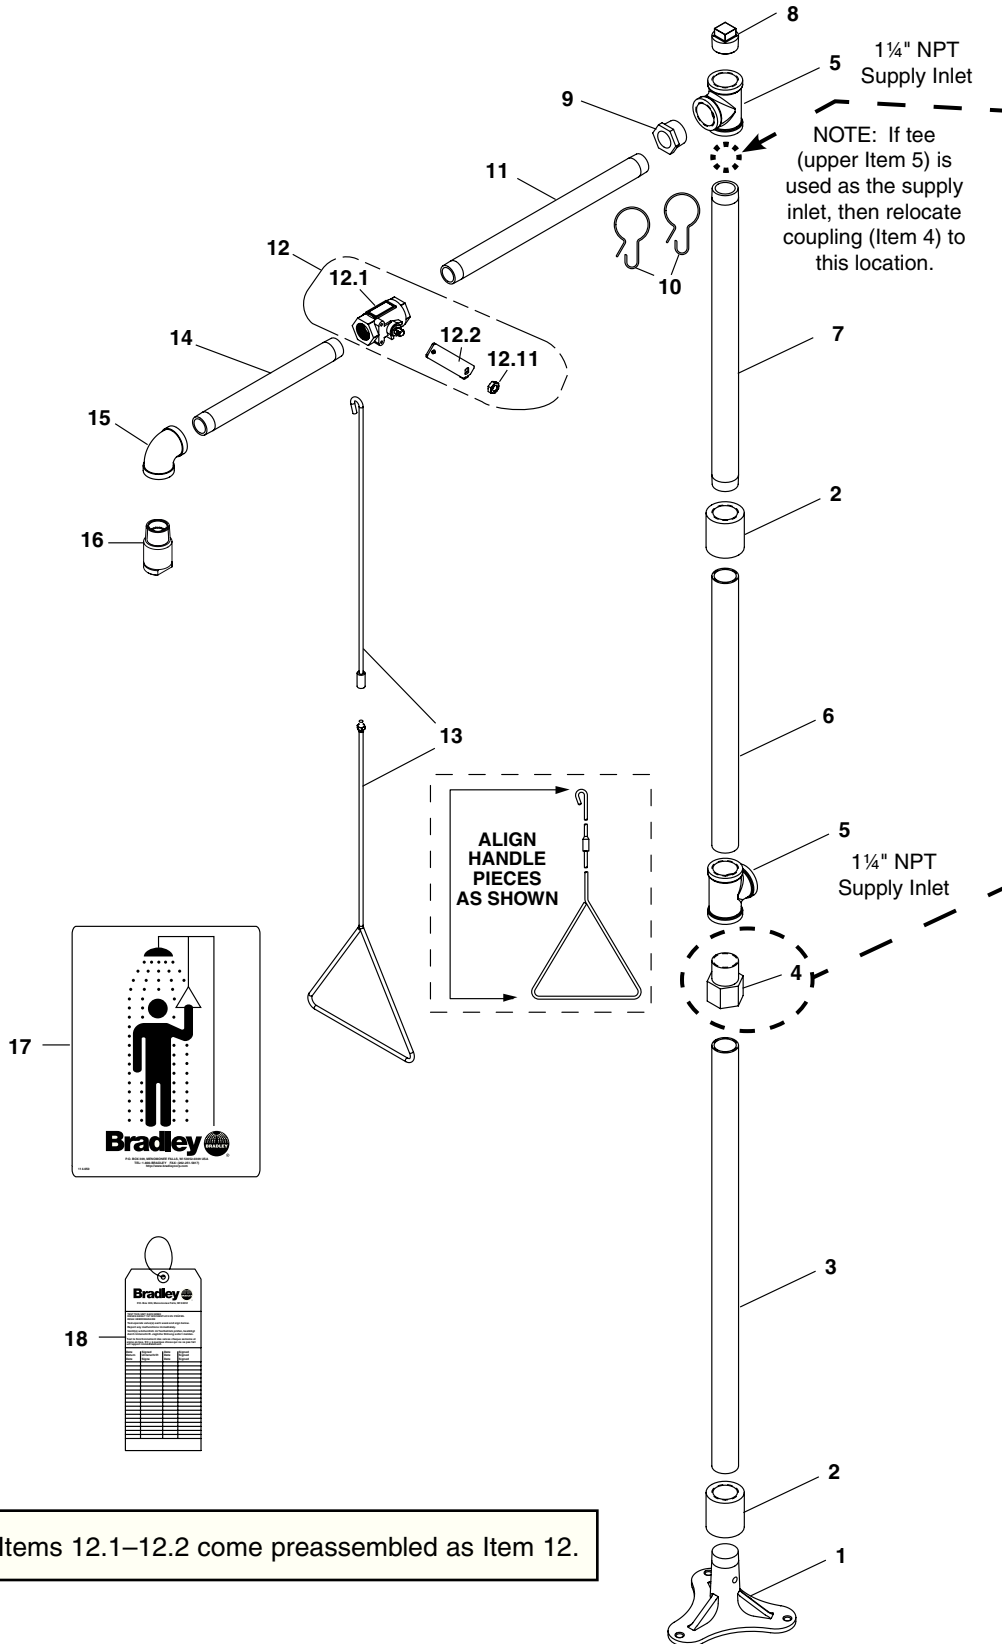

NOTE: Items 12.1-12.2 come preassembled as Item 12.

## Parts List

Item	Part No.	Qty.	Description	Item	Part No.	Qty.	Description
1	131-062	1	Base	12.1	S27-276	1	Ball Valve 1" with Jam Nut
2	269-1048	2	Coupling	12.11	161-079	1	Jam Nut only
3	113-1182	1	Pipe, Stainless Steel 1¼" NPT x 32"	12.2	128-142	1	Handle
4	169-1066	1	Pipe Plug Coupling	13	S90-365D	1	Pull Rod
5	269-237	2	Tee 1¼" NPT	14	113-006MN	1	Pipe 1" NPT x 12"
6	113-541	1	Pipe 1¼" NPT x 19"	15	169-1074	1	90° Elbow 1" NPT
7	113-583	1	Pipe, Stainless Steel 1¼" NPT x 22"	16	S24-191	1	Stainless Steel Showerhead Assembly
8	269-238	1	Sq. Head Pipe Plug 1¼" NPT	17	114-050	1	Safety Sign
9	269-236	1	Reducing Bushing	18	204-421	1	Emergency Inspection Tag
10	151-001	2	Curtain Hook	19	269-915	1	Grip Pad (not shown)
11	269-434S	1	Pipe Stainless Steel 1" NPT x 17"				
12	S30-061	1	Ball Valve Assembly				